


Solar Power Generation System Grid Intertie, with Batteries for the Killian-Lee Residence Los Altos Hills, CA

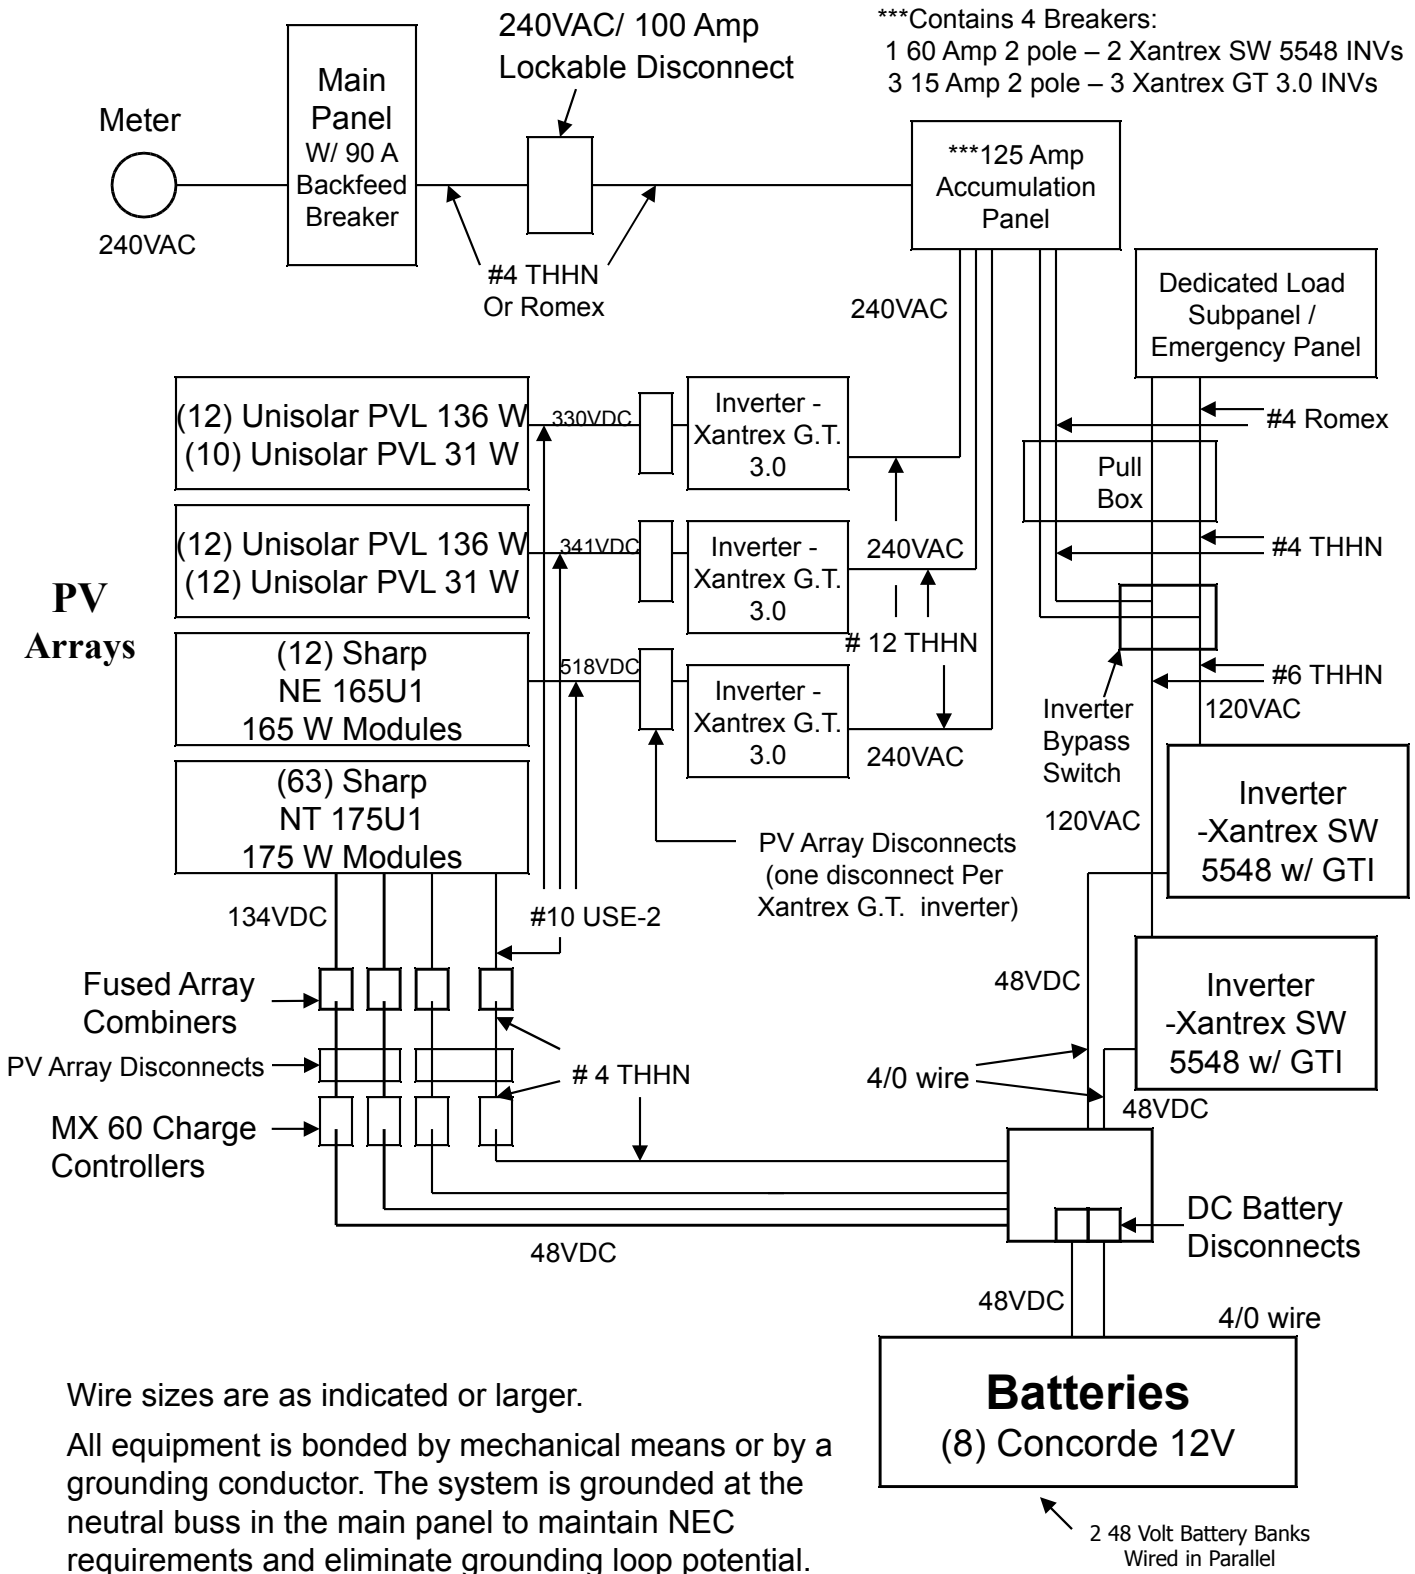

Wire sizes are as indicated or larger.
All equipment is bonded by mechanical means or by a grounding conductor. The system is grounded at the neutral buss in the main panel to maintain NEC requirements and eliminate grounding loop potential.